


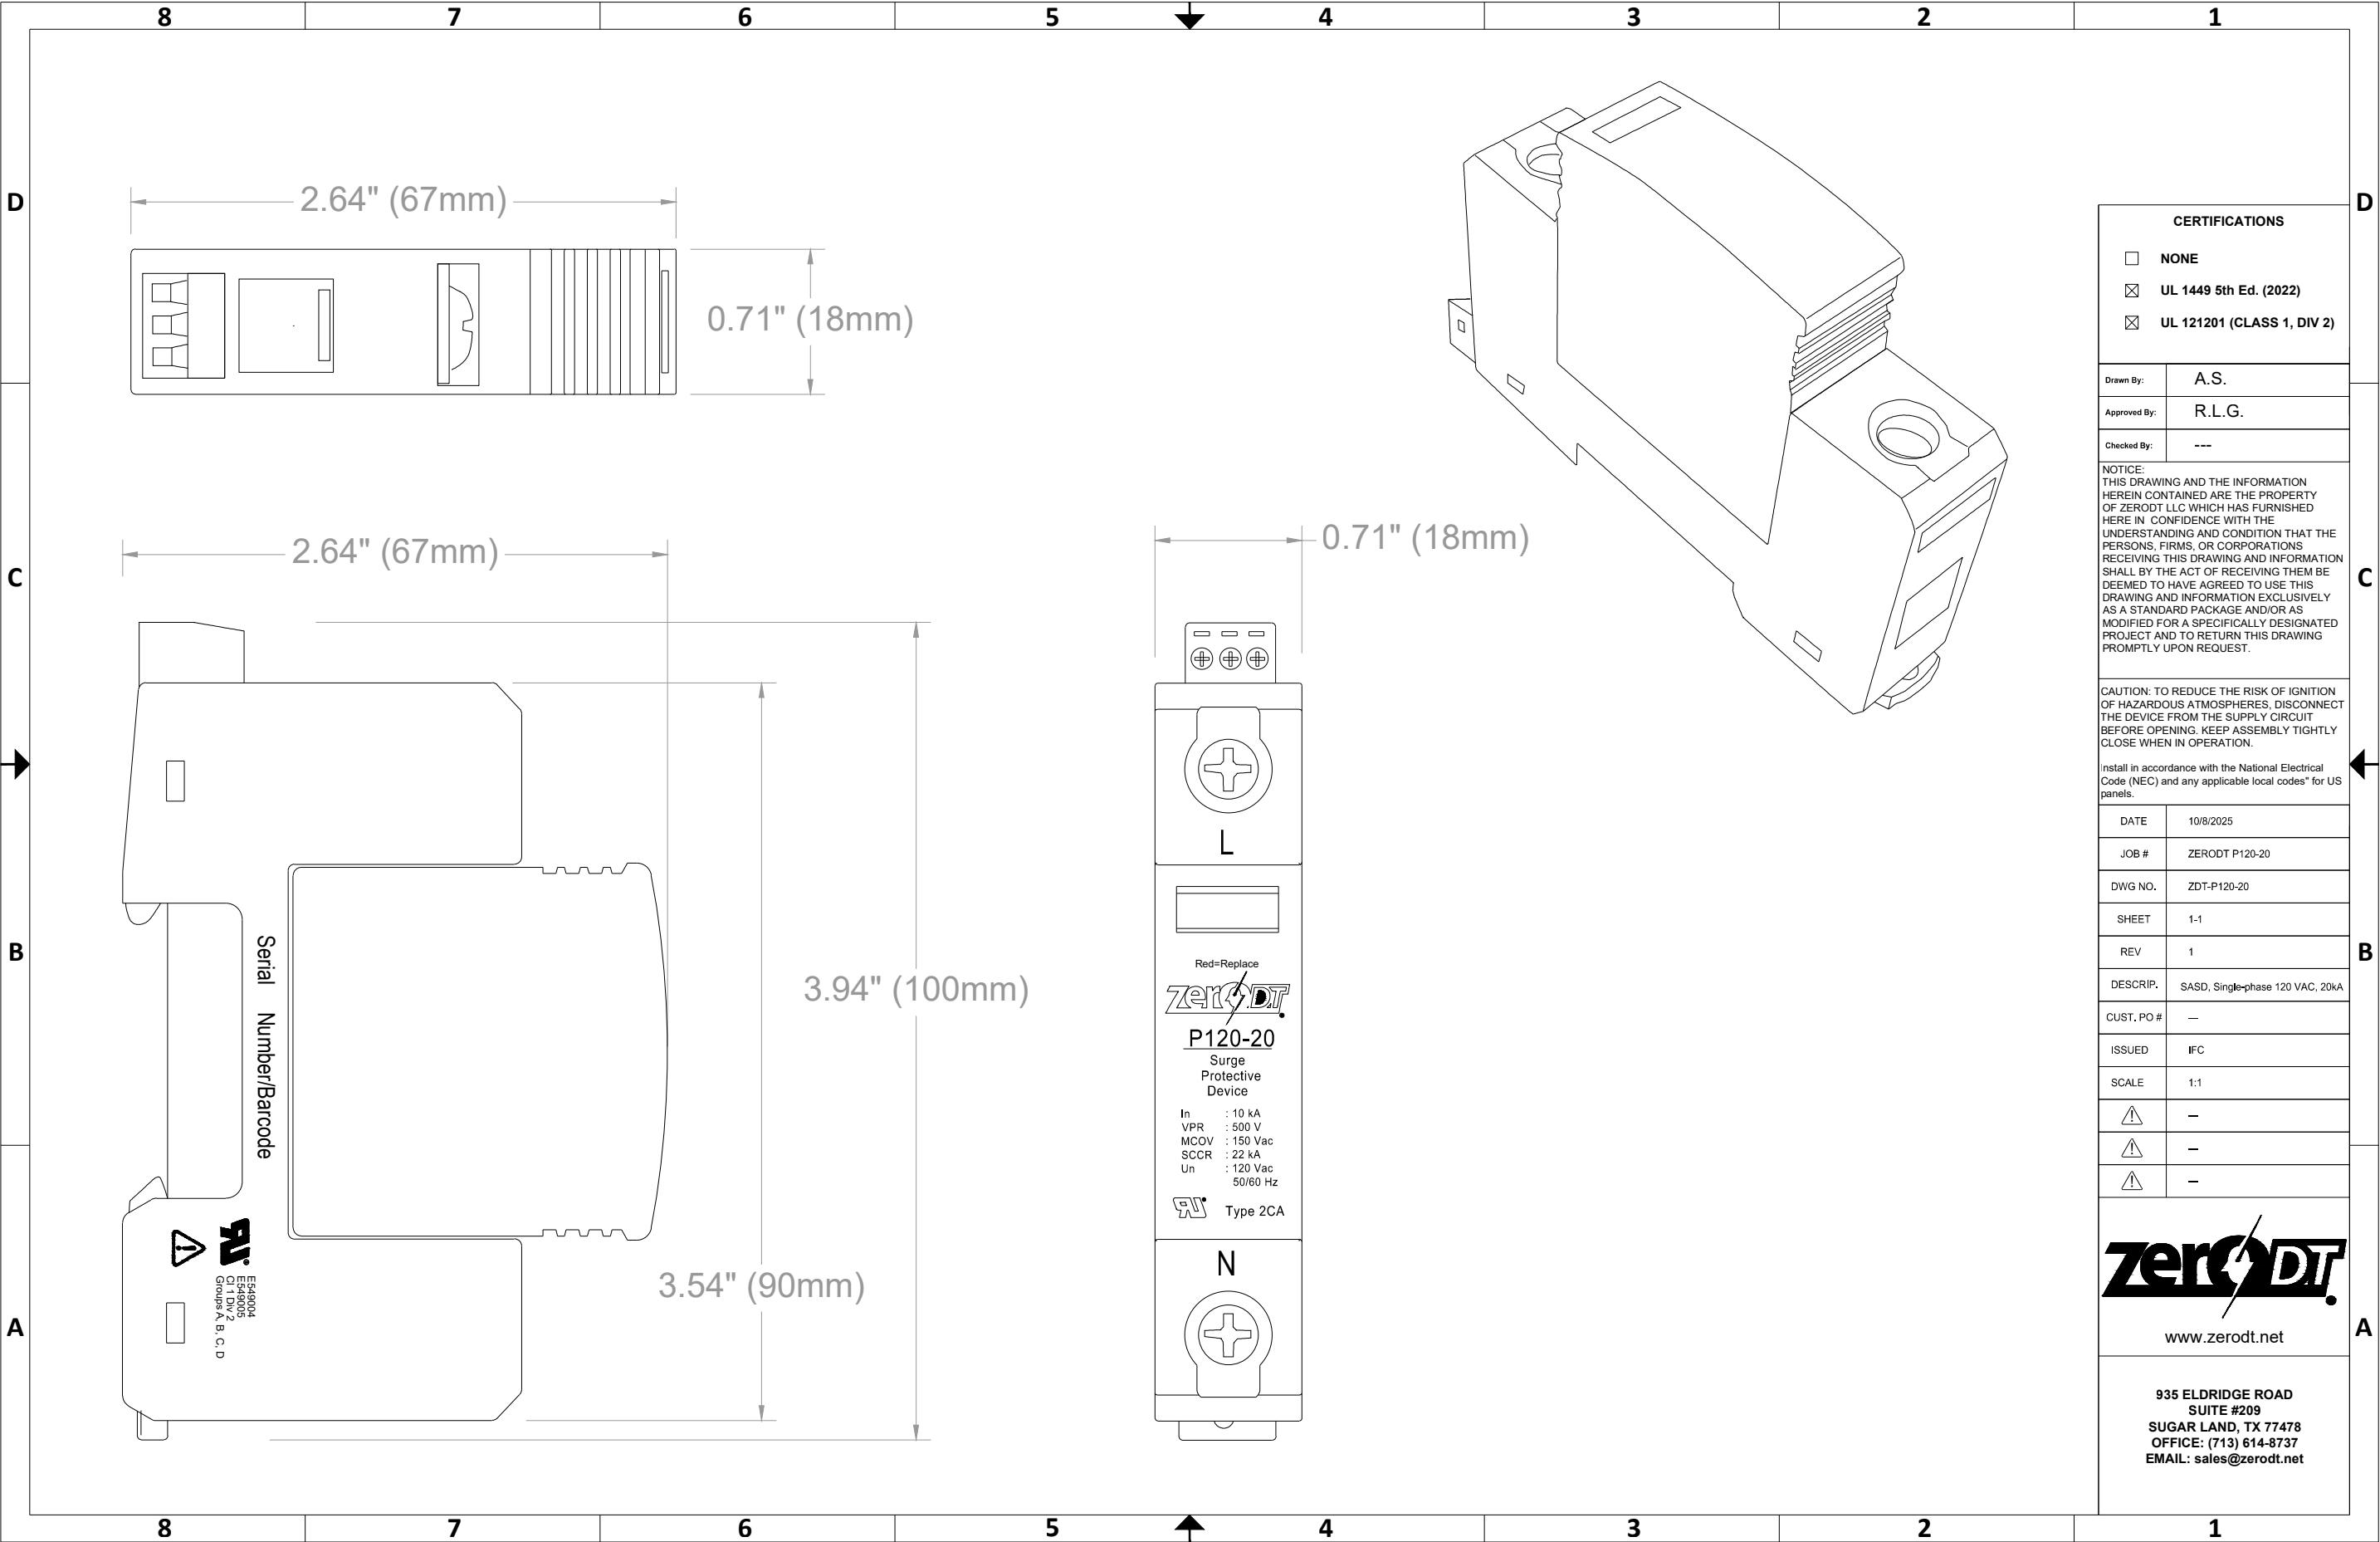

CERTIFICATIONS	
☐	NONE
☒	UL 1449 5th Ed. (2022)
☒	UL 121201 (CLASS 1, DIV 2)

Drawn By:	A.S.
Approved By:	R.L.G.
Checked By:	---

NOTICE:
THIS DRAWING AND THE INFORMATION
HEREIN CONTAINED ARE THE PROPERTY
OF ZERO DT LLC WHICH HAS FURNISHED
HERE IN CONFIDENCE WITH THE
UNDERSTANDING AND CONDITION THAT THE
PERSONS, FIRMS, OR CORPORATIONS
RECEIVING THIS DRAWING AND INFORMATION
SHALL BY THE ACT OF RECEIVING THEM BE
DEEMED TO HAVE AGREED TO USE THIS
DRAWING AND INFORMATION EXCLUSIVELY
AS A STANDARD PACKAGE AND/OR AS
MODIFIED FOR A SPECIFICALLY DESIGNATED
PROJECT AND TO RETURN THIS DRAWING
PROMPTLY UPON REQUEST.

CAUTION: TO REDUCE THE RISK OF IGNITION
OF HAZARDOUS ATMOSPHERES, DISCONNECT
THE DEVICE FROM THE SUPPLY CIRCUIT
BEFORE OPENING. KEEP ASSEMBLY TIGHTLY
CLOSE WHEN IN OPERATION.

Install in accordance with the National Electrical
Code (NEC) and any applicable local codes* for US
panels.

DATE	10/8/2025
JOB #	ZERODT P120-20
DWG NO.	ZDT-P120-20
SHEET	1-1
REV	1
DESCRIP.	SASD, Single-phase 120 VAC, 20kA
CUST. PO #	—
ISSUED	IFC
SCALE	1:1
	—
	—
	—



935 ELDRIDGE ROAD
SUITE #209
SUGAR LAND, TX 77478
OFFICE: (713) 614-8737
EMAIL: sales@zerodt.net